



## Carlo Gavazzi - EM21-72D.AV5.3.X.OX. P/F.BP - Summary Sheet

### Summary

The EM21 is a 5 Amp, CT operated, three-phase energy meter with MID approval. This meter is unique in that it can be installed either as a DIN Rail or 72x72mm Panel Mounted meter, making it flexible for installers.

It measures a wealth of parameters including Active Energy (kWh) and Reactive Energy (kVAh), Line to Line and Line to Neutral Voltages (V), Current (I), Power Factor (PF) and Frequency (Hz). It also measures Active Power (W), Reactive Power (Var) and Apparent Power (kVAh) both for each phase and cumulatively.

This model comes with a single programmable pulse output as standard which can be programmed to produce a pulse anywhere between 0.01 and 9.99 kWh. The pulse length options are 30ms, 100ms or 120ms.

This meter is suitable for 3Ph balanced and unbalanced loads as well as single and 2 phase supplies.

N.B. This meter can be pre-wired into a DIN-Rail or Panel Mounted enclosure. [Click here](#) to see our full range of Enclosures, or [click here](#) to find out more about our Pre-Wiring Service.

### Product Code

**Meter Type**  
**Fitting Type**  
**Max Current (Amps)**  
**MID Approved**  
**Smart**  
**Input Type**  
**Output Type**  
**Tariffs**  
**Import / Export**  
**Module Width**  
**Availability**  
**Condition**  
**Brand**  
**Country of Manufacture**


**TPDCGEM21OP**

**Three Phase**  
**DIN Rail & Panel Mounted**  
**5**  
**Yes**  
**No**  
**Current Transformer**  
**Pulse**  
**Single**  
**Import Only**  
**4**  
**Next Day**  
**New**  
**Carlo Gavazzi**  
**Italy**


### Measured Parameters

Active Energy (kWh)	✓	Line Power Factor (PF)	✓
Active Power (W)	✓	Line Reactive Power (kVAR)	✓
Apparent Energy (kVAh)	✗	Line to Line Voltage (V)	✓
Apparent Power (VA)	✓	Line to Neutral Voltage (V)	✓
Average Current (I)	✗	Maximum Current (I)	✗
Average Power Demands (W)	✗	Maximum Power Demands (W)	✗
Average Voltage (V)	✗	Maximum Voltage (V)	✗
Current (I)	✗	Power Factor (PF)	✓
Current in Neutral (I)	✗	Reactive Energy (kVAh)	✓
Frequency (Hz)	✓	Reactive Power (VAR)	✓
Hours Run (hr)	✗	Total Harmonic Distortion (Amps)	✗
Line Active Power (W)	✓	Total Harmonic Distortion (Volts)	✗
Line Apparent Power (kVA)	✓	Voltage (V)	✓
Line Current (I)	✓		

### Dimensions

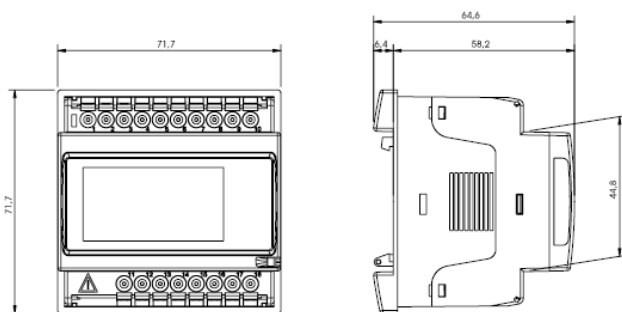

### Wiring Diagram

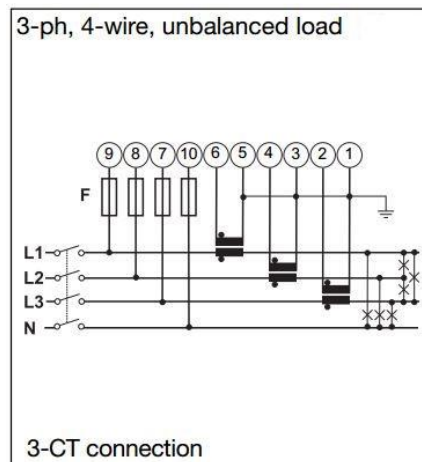

**Web: [www.spwales.com](http://www.spwales.com) | Email: [sales@spwales.com](mailto:sales@spwales.com) | Phone: 01803 295430 | Fax: 01803 212819**

While Stephen P Wales Ltd has made every reasonable effort to ensure the accuracy of this information, Stephen P Wales Ltd does not guarantee that it is error-free, nor does Stephen P Wales Ltd make any other representation, warranty or guarantee that the information is accurate, correct, reliable or current. Stephen P Wales Ltd reserves the right to make any adjustments to the information contained herein at any time without notice.